


AIRTECT



ULTIMATE Plastic Leak Alarm System

& 203 / (7 (+27 5811 (5 02 / ' 3527 (&7, 21
' (7 (& 7 <285 +27 5811 (5 / (\$. 6 (\$5 / <


INSTALLATION EXAMPLE USING LA512-2L-S **ULTIMATE** STAND ALONE MANIFOLD

'POINT' Plastic Leak Detection Zones:

- 8 used on the Nozzle Gates (4 unused)

'LOOP' Plastic Leak Detection Zones:

- 1 loop circuit used on the 8 x Nozzle/Manifold interfaces
- 1 loop circuit used on the rear Inlet Bushing/Manifold interface

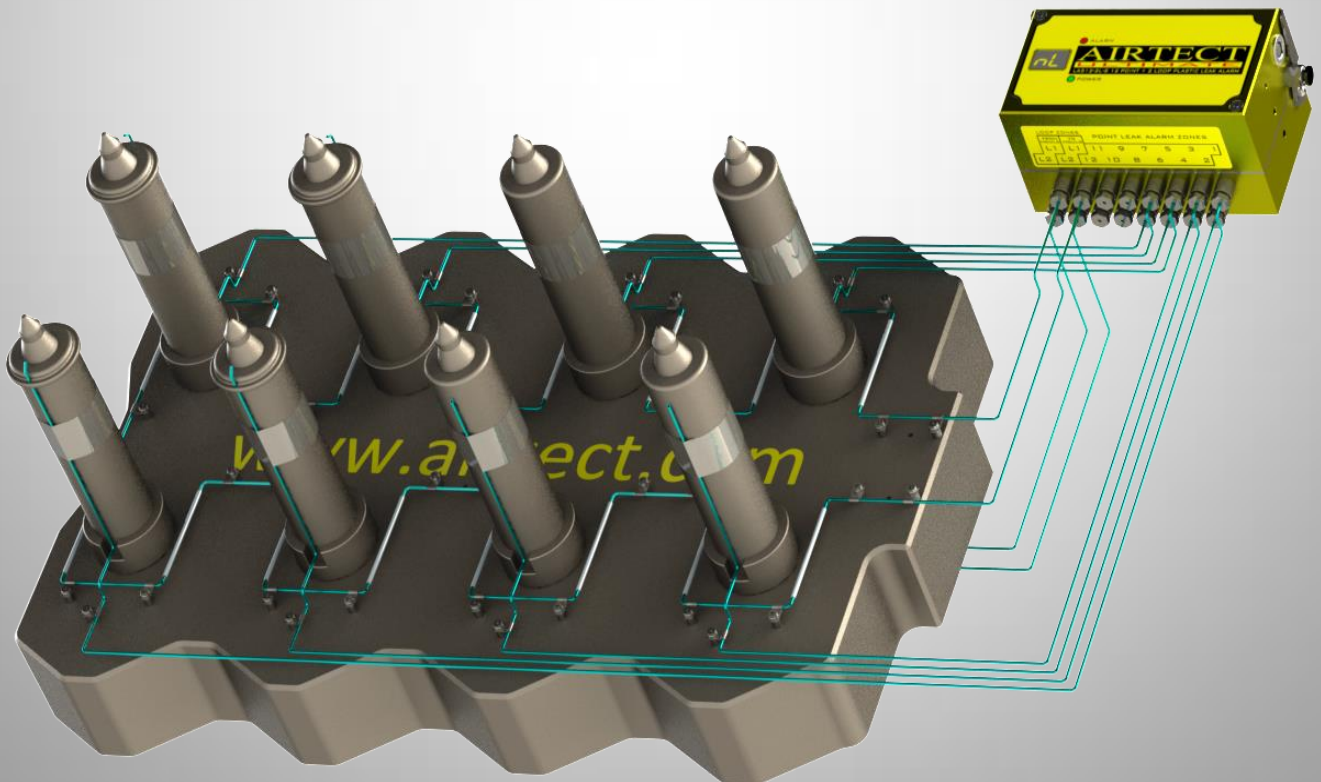

DISTRIBUTED BY:

Plastixs, LLC • 151 Memorial Drive, Unit H • Shrewsbury • MA • 01545

www.plastixs.com / AIRTECT / sales@plastixs.com